



FORT MOJAVE MESA FIRE DEPARTMENT UNIVERSAL PREVENTION FORM

Plan Review Inspection Smoke Detector LPG Installation Permit Complaint

Business / Project Site Address: _____

Business / Project Name: _____

Contact Name: _____ Contact Phone #: _____

Fax #: _____ E-Mail Address: _____

Contact Address: _____

PLAN REVIEW REQUEST

Type of Review: Building Subdivision Fire Alarm System Fire Hydrant/Water Main
 Fire Sprinkler System Hood Suppression System Other _____

Type Construction: _____ Type Occupancy: _____ Sq. Feet: _____

Number of Plans Required: _____ Building/Subdivision = one set (will be returned)
All others = one set for Fire Department plus additional sets to be returned

SMOKE DETECTOR

New Smoke Detector New Batteries Service Only Other _____

INSPECTION

LPG TANK INSTALLATION PERMIT (attach LPG Tank Installation Checklist)

Size of Tank (GWC): _____
Sketch, on the reverse side of this form, a site plan of the tank and location. See instructions on reverse side.

When you are ready for an inspection, please call (928) 768-9181, ext.24

COMPLAINT

Office Use Only

Date Requested: _____ Taken By: _____ Assigned To: _____

Completed By: _____ "C" Number: _____ Date: _____

Fee: \$ _____ Date Paid: _____ Check #: _____ Initials: _____

Contact Log: (if more space is needed, use reverse side of sheet)

	<u>Date</u>	<u>Emp. #</u>	<u>Description of Contact</u>
1.	_____	_____	_____
2.	_____	_____	_____



FORT MOJAVE MESA FIRE DEPARTMENT UNIVERSAL PREVENTION FORM

LPG Tank Installation Permit

Sketch below a site plan of the tank and location of the installation with all exposures including, but not limited to, buildings, driveways, fences, walls, washes, etc. with dimensions and distance in feet from the exposure to the tank.

Tank Site Sketch

A large, empty rectangular box with a thin black border, intended for the applicant to draw a site plan showing the tank location, dimensions, and distances to various exposures.

Applicant Signature: _____

Date: _____



FORT MOJAVE MESA FIRE DEPARTMENT UNIVERSAL PREVENTION FORM

LPG Tank Installation Checklist

To assist in ensuring the proper installation of a propane gas tank, please verify the following checklist.

1. Yes No Are long dry grass, weeds, brush, and other combustible materials 10 feet or more from the tank?
2. Yes No Is the tank installed according to **Diagram A** on the reverse side of this form? **Diagram A** shows the correct distance the tank should be installed from buildings, including decks and covered patios, and building openings.
(Keeps accidental release of gas from accumulating in or under the building).

Tanks less than 125 gallons may be installed next to a building. All filling connections and/or pressure relief valves must be 10 feet from window air conditioners, air intake appliances, or any sources of ignition.

ASME tank pressure relief valves must be 10 feet from sources of ignition and 5 feet from building openings.
DOT tank pressure relief valves may be 3 feet from any building opening, and 5 feet from sources of ignition.
3. Yes No Does the tank have a manual valve to shut off the propane gas supply in case of an emergency? (See manual valve drawing on Diagram B on the reverse side of this form.)
4. Yes No Does the pressure relief valve have a waterproof cap protecting it from rain? Caution: Do not move the relief valve, and never lean over the relief valve.
5. Yes No Is the regulator securely attached (to either the tank or building) and protected from rain and other weather conditions? Regulators may be installed outside the dome, if they are secured and the vent is in the downward position.
6. Yes No Is the tank located inside a fenced area (constructed of wood or any other materials)? If the answer is yes, please answer the following:

 Yes No The fence around my tank does not have a roof.

 Yes No The fence is 12 inches or less above the top of the dome covering.

 Yes No The fence is 3 feet from the tank on all sides. (Except for the side of your house)

 Yes No If the fence is made of wood, the entire bottom edge of the fence is at least 6 inches or more off the ground.

 Yes No If the fence is made of concrete or masonry blocks, half or more of the bottom edge of the fence is 6 inches or more off the ground.
7. Yes No If the tank is close to an alley, driveway, or parking area, is the tank, regulator, and piping protected from possible vehicle impact?
8. Yes No Does the tank sit on a foundation that provides support to keep the tank from tipping over or sinking into the ground? (Examples of foundations include concrete blocks, concrete, or paving.)

Signature: _____ Phone: _____ Date: _____


My tank is: (please check one of the following) ASME DOT



FORT MOJAVE MESA FIRE DEPARTMENT UNIVERSAL PREVENTION FORM

LPG Tank Installation Checklist

DIAGRAM A.

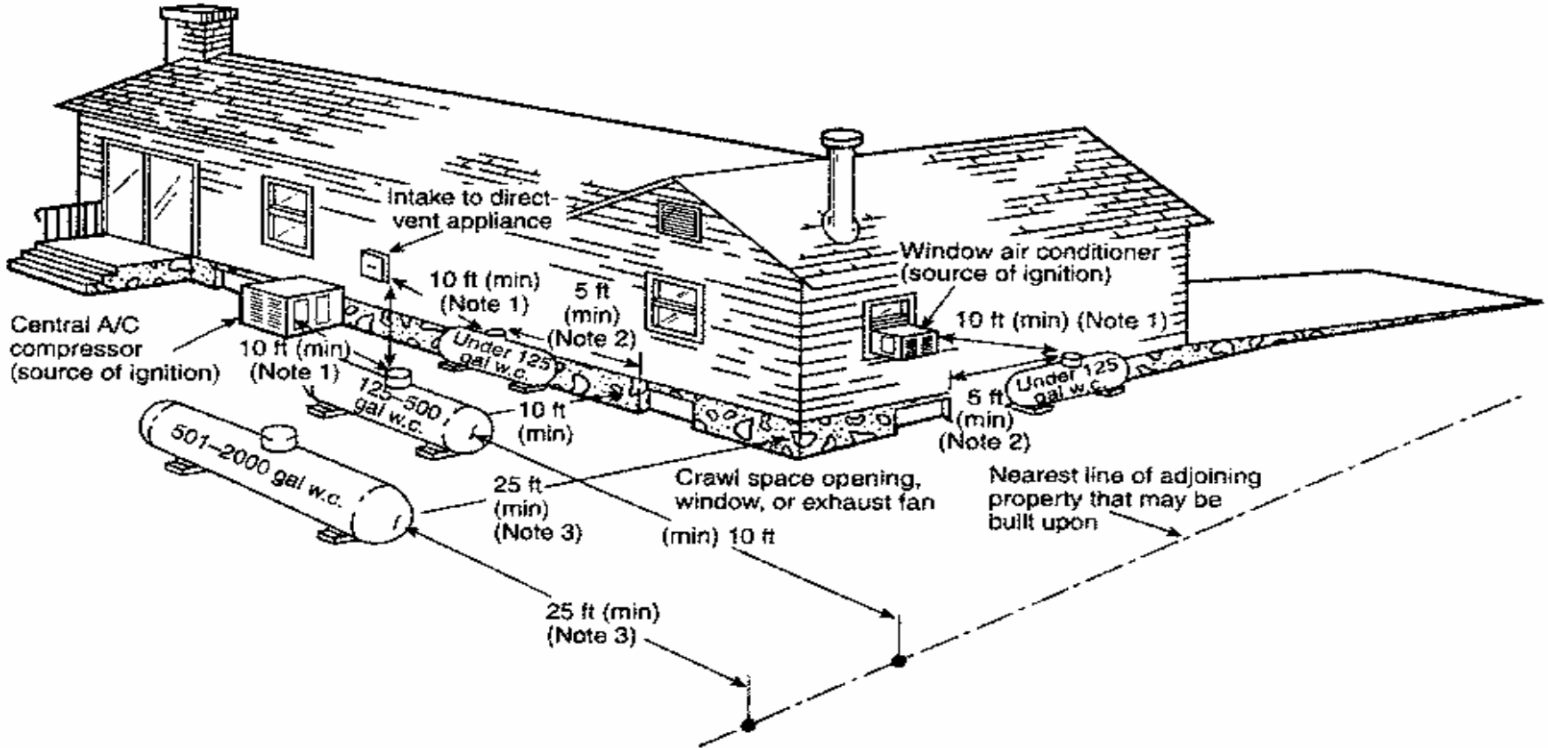

Note 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (such as open flames, window A/C, and compressors), intake to a direct-vented gas appliance, or intake to a mechanical ventilation system.

Note 2: Cylinders shall not be located and installed underneath any building unless the space is open to the atmosphere for 50 percent of its perimeter or more.

Note 3: This distance may be reduced to no less than 10 ft for a single container of 1200 gal (4.5 m³) water capacity or less, provided the container is at least 25 ft from any other LP-Gas container of more than 125 gal (0.5 m³) water capacity.

DIAGRAM B.

